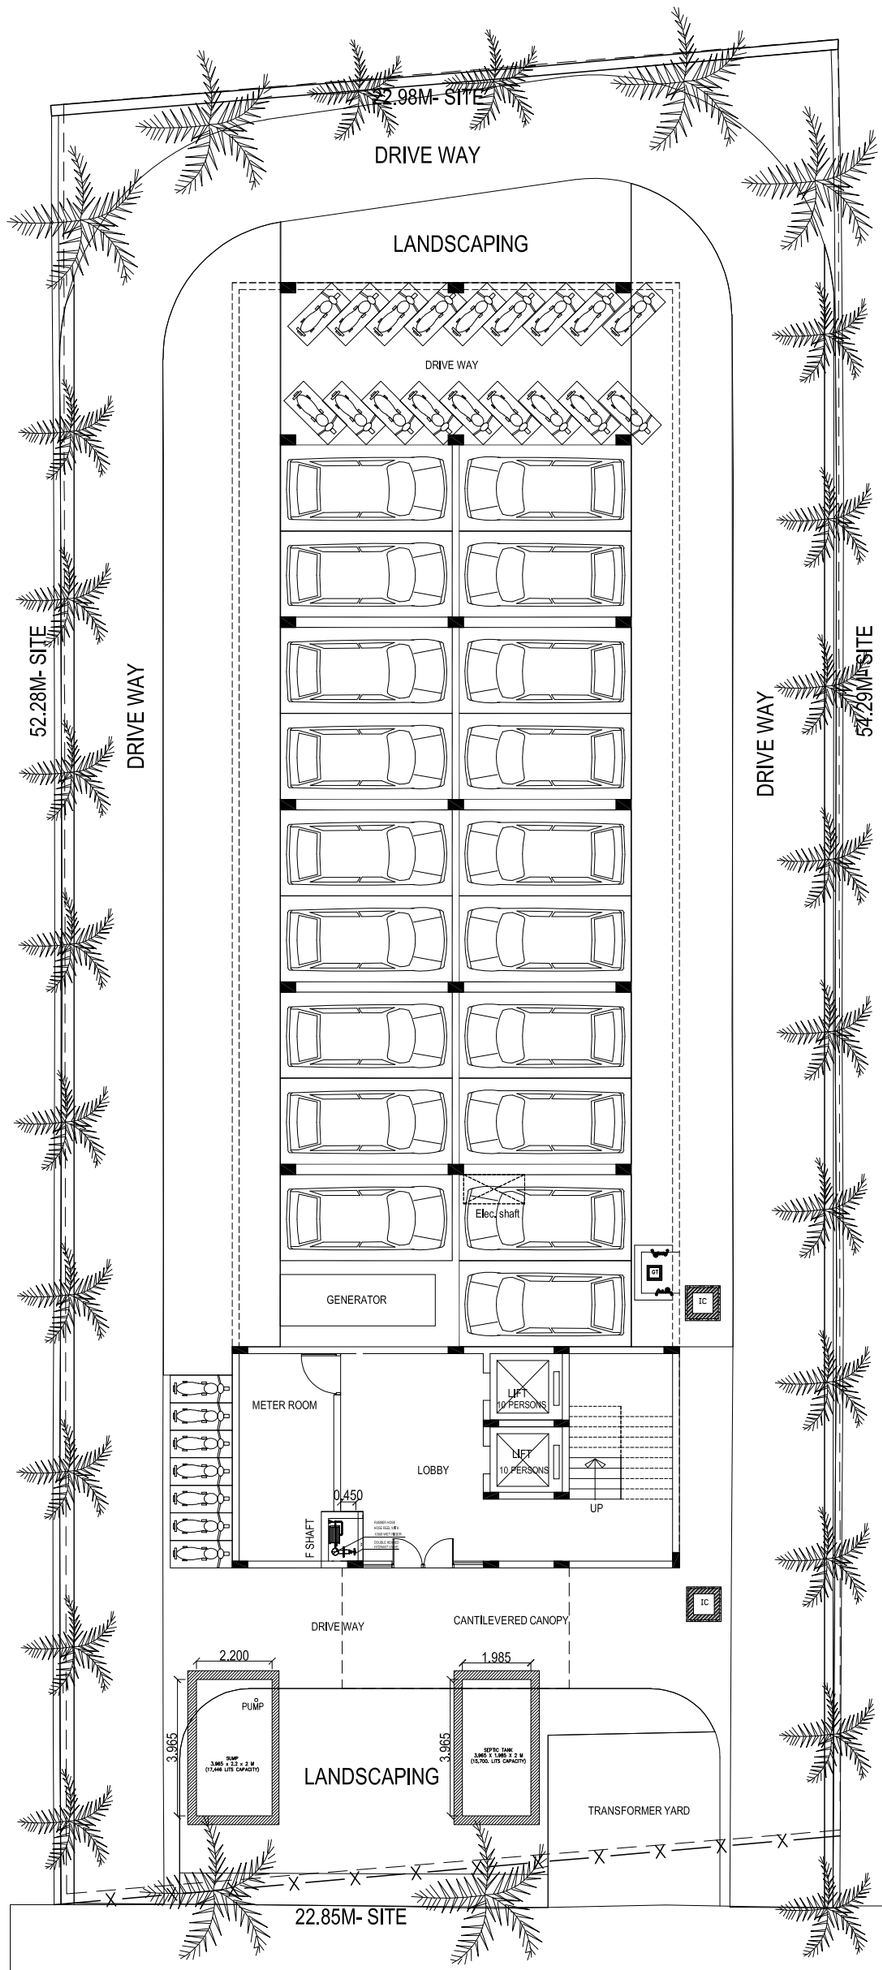



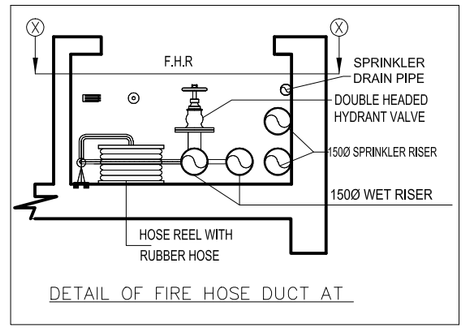

NOTES:

1. ANY DISCREPANCY IN THE DRAWING, SHALL BE INFORMED TO THE CONSULTANTS IMMEDIATELY.
2. FIRE ESCAPE STAIRCASE AT TRAVEL DISTANCE OF 30.0M, AND WETRISER PER STAIRCASE OR PER 1000 Sqm. FOR FLOORS ABOVE GROUND LEVEL
3. SAND BUCKETS SHALL BE PROVIDED AT CAR PARKING AREA , 2 Nos FOR 8 CARS
4. ABC TYPE FIRE EXTINGUISHER SHALL BE PROVIDED AT TRANSFORMER YARDS, GENERATOR ROOM ENTRANCE, ELECTRICAL ROOM ENTRANCE, HSD YARDS & CAR PARKING AREA 1 NO PER 8 CARS
5. ALL ISOLATING VALVES SHOULD BE OF LOCKABLE TYPE.
6. STAIRCASES HEADROOM HEIGHT WILL BE 2.20M .
7. STAIRCASES HAND RAIL HIEGHT WILL BE 1.00M .

PROJECT:

PROPOSED OFFICE BUILDING
AT PALLIKARANAI
CHENNAI

CLIENT:

H L L LIFE CARE LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
HITES
(HLL INFRA TECH SERVICES LTD)
VELACHERRY,CHENNAI
web : www.lifecarehll.com

PROJECT CONSULTANT:

CARE CONSULTANTS AND CONTRACTORS
CHINMAYA NAGAR STAGE - II,
25/C, AANI STREET,
VIRUGAMBAKKAM,
CHENNAI - 600 092.
E-MAIL: caretech1995@gmail.com

ARCHITECTS:

AKSHARA ASSOCIATES
ARCHITECTS & ENGINEERS
Plot No. 82, 1st Floor, Gopalan Street,
Vasudevan Nagar, Chennai 600 083
Tel / Fax : 044 2471 7557
Mobile : 94440 02589
Email I.D. : aksharaassociates@yahoo.in
sivababu2005@yahoo.co.in

MEP CONSULTANTS:

CARE CONSULTANTS AND CONTRACTORS

STRUCTURAL CONSULTANTS:

C.KANNAN B.E., M.E(STRUCTURE)
L1/932, SSK ILLAM,
THIRIVALLUVAR NAGAR, THIRUVANMIYUR,
CHENNAI-41.
MOBILE NO: 098412 49815.
E-MAIL:kannankds2007@rediffmail.com

DRAWING TITLE

STILT FLOOR FIRE FIGHTING LAYOUT

Drawn: V.S	Checked: V.S
Approved: KRISHNAN	Scale: 1:100
Date: 16.07.15	Sheet: A2
Drg No: CC\FF\PJ20\FF-01	Rev:R0
File Path: C:\Users\HLL\Desktop\MEP\FIRE FIGHTING DRAWING\HLL Project Fire Fighting Drawing-2010.dwg	