




ITEM NO.	DESCRIPTION	QUANTITY
1.	50 x 6 mm COPPER FLAT BAR EARTH CONDUCTOR	AS REQUIRED
2.	40Ø GALVANISED MILD STEEL PIPE	AS REQUIRED
3.	600mm X 600mm X 3.15mm THK COPPER PLATE	AS REQUIRED
4.	CONCRETE INSPECTION PIT AND HINGED COVER	1 EACH
5.	12Ø X 50mm LONG STAINLESS STEEL BOLT , NUT , FLAT WASHER AND SPRING WASHER	AS REQUIRED

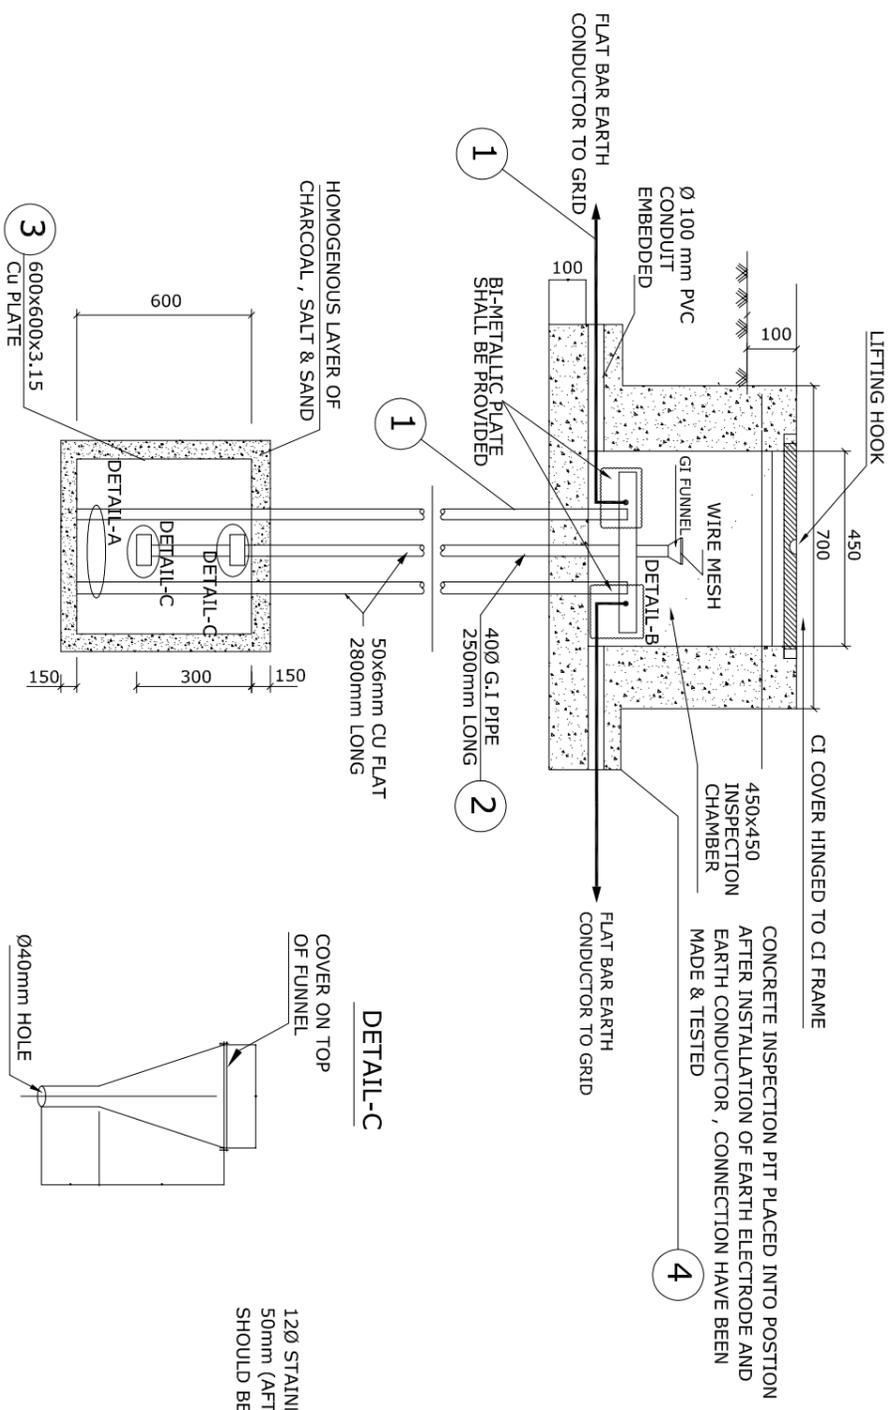


DETAIL-C
COVER ON TOP OF FUNNEL
Ø40mm HOLE

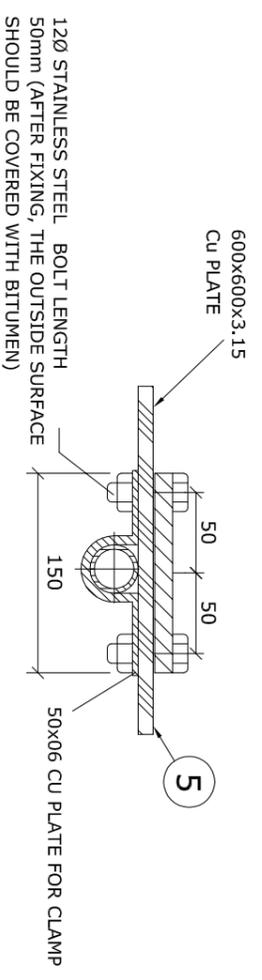

DETAIL-B
12Ø STAINLESS STEEL BOLT LENGTH 50mm (AFTER FIXING, THE OUTSIDE SURFACE SHOULD BE COVERED WITH BITUMEN)

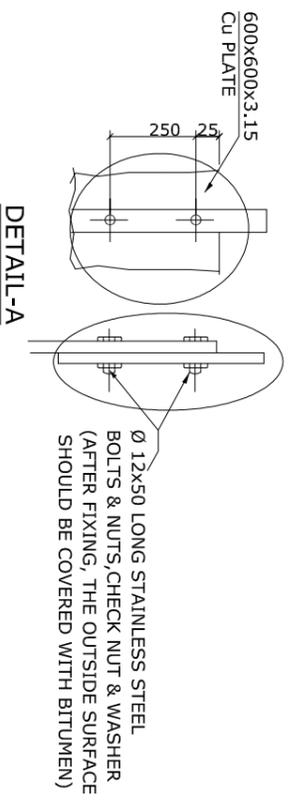

DETAIL-A
Ø 12x50 LONG STAINLESS STEEL BOLTS & NUTS,CHECK NUT & WASHER (AFTER FIXING, THE OUTSIDE SURFACE SHOULD BE COVERED WITH BITUMEN)

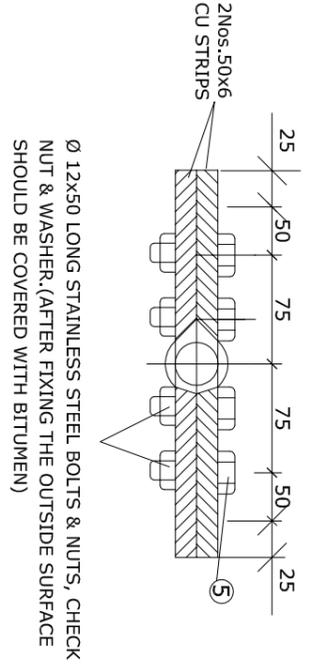

DETAIL-B
Ø 12x50 LONG STAINLESS STEEL BOLTS & NUTS, CHECK NUT & WASHER.(AFTER FIXING THE OUTSIDE SURFACE SHOULD BE COVERED WITH BITUMEN)

TYPICAL ARRANGMENT OF TRATED COPPER PLATE EARTH ELECTRODE

- NOTES:-
1. EARTH PIT SHALL BE ATLEAST 2M. AWAY FROM BUILDING WALLS.
 2. THE DISTANCE BETWEEN EARTH PITS SHALL BE MINIMUM OF 3M.
 3. ALL DIMENSION ARE IN MILLIMETERS (mm)
 4. ALL NUT , BOLT AND WASHER SHALL BE STAINLESS STEEL
 5. INSPECTION PITS SHALL BE INSTALLED 100mm ABOVE (FGL) SURROUNDING GRADE WITH IN PAVED AREAS.
 6. INSPECTION PIT NO TO BE PAINTED ON COVER , BASE AND WHITE LETTERS.

Rev.	Date	Changed	Checked	Kind of revision

Project name : INTEGRATED VACCINES COMPLEX, HIL BIOTECH LIMITED,		Project No.: 120310	
Location: CHEENGALPATTU		Issued To: nne pharmaplan	
Description: TYPICAL DRAWING FOR COPPER PLATE EARTH ELECTRODES		Date: 26.04.2014	
Drawn: NYKK		Name: NYKK	
Checked: BAKD		Date: 26.04.2014	
Approved: VNIR		Name: BAKD	
Scale: NTS		Date: 26.04.2014	
Units: mm		Size: A4	
Drawing no: NP/120310/ELC(STD)/S1/01		Rev: 00	