
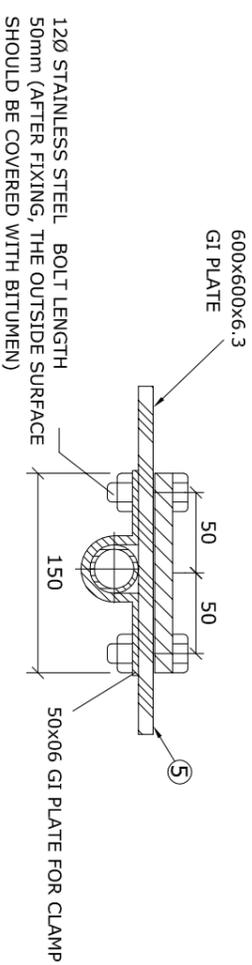
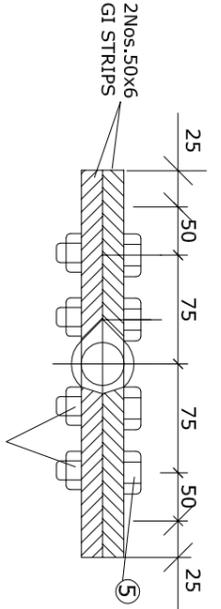
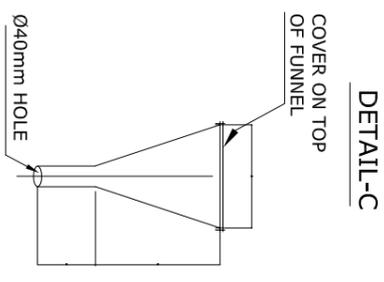
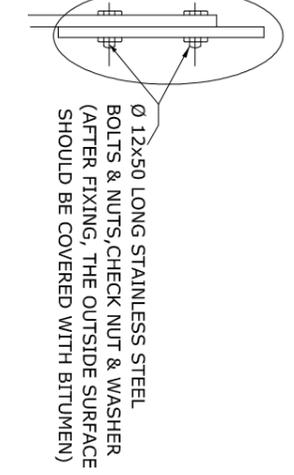
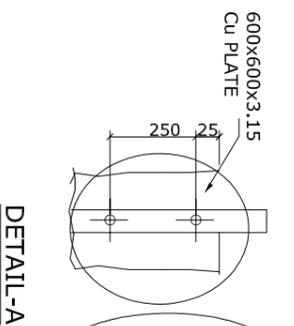


ITEM NO.	DESCRIPTION	QUANTITY
1.	50 x 6 mm GI FLAT BAR EARTH CONDUCTOR	AS REQUIRED
2.	40Ø GALVANISED MILD STEEL PIPE	AS REQUIRED
3.	600mm X 600mm X 6.3mm THK GI PLATE	AS REQUIRED
4.	CONCRETE INSPECTION PIT AND HINGED COVER	1 EACH
5.	12Ø X 50mm LONG STAINLESS STEEL BOLT , NUT , FLAT WASHER AND SPRING WASHER	AS REQUIRED

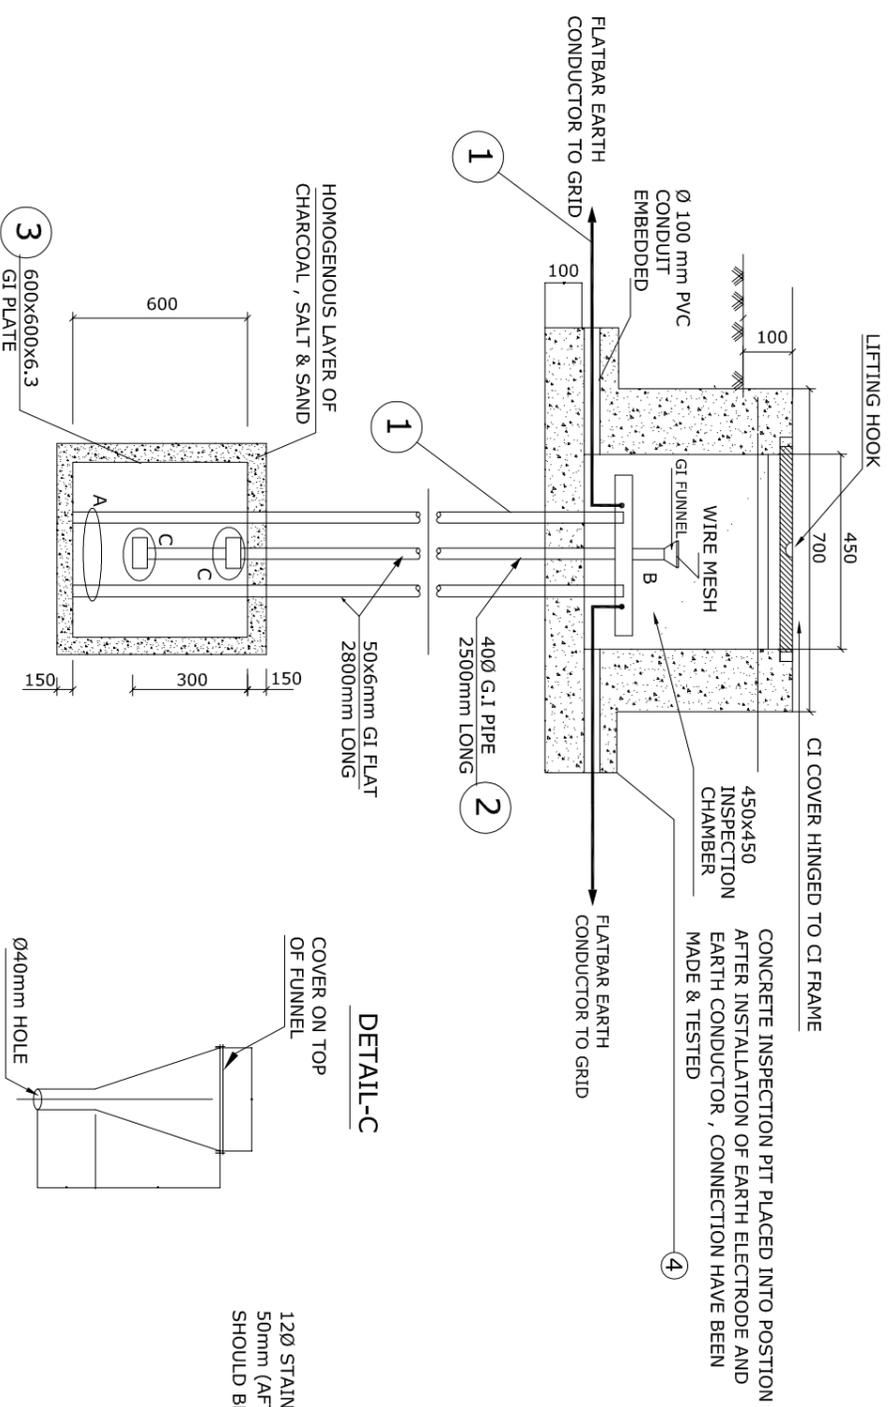

- NOTES:-**
1. EARTH PIT SHALL BE ATLEAST 2M. AWAY FROM BUILDING WALLS.
 2. THE DISTANCE BETWEEN EARTH PITS SHALL BE MINIMUM OF 3M.
 3. ALL DIMENSION ARE IN MILLIMETERS (mm)
 4. ALL NUT , BOLT AND WASHER SHALL BE STAINLESS STEEL
 5. INSPECTION PITS SHALL BE INSTALLED 100mm ABOVE (FGL) SURROUNDING GRADE WITH IN PAVED AREAS.
 6. INSPECTION PIT NO TO BE PAINTED ON COVER , BASE AND WHITE LETTERS.

TYPICAL ARRANGMENT OF TRATED G.I PLATE EARTH ELECTRODE

DETAIL-B

Rev.	Date	Changed	Checked	Kind of revision	No. of prints	Date	Issued To

Project:		Project No.:	
INTEGRATED VACCINES COMPLEX, HIL BIOTECH LIMITED,		120310	
Location		Name	
CHENGALPATTU		nne pharmaplan	
		#12, Achiah Shetty Layout, Bangalore - 560 080., INDIA.	

Description:		Date	Name
TYPICAL DRAWING FOR GI PLATE EARTH ELECTRODES		26.04.2014	NYKK
Drawn	26.04.2014	BAKD	
Checked	26.04.2014	VNIR	
Scale:NTS	Units : mm	Size : A4	
Drawing no:	NP/120310/ELC(STD)/S1/02		
Rev.	00		